

# SANITARY CERTIFICATE


No. 28/2025

This is to certify that necessary sanitary arrangements made by the applicant

Sri/Smt.....*M.r. uckula M.R*.....  
.....*Chiomaya Vidyalyaya Palace corner, Kollengode*.....  
Owner/Licensee of .....*Chiomaya Vidyalyaya Palace corner, Kollengode*.....  
are satisfactory at the time of my inspection on.....*17.06.2025*.....  
The Certificate valid up to .....*18.06.2026*.....

This Certificate issued only for the purpose of obtaining license from Grama Panchayath  
Kollengode.

Any violation of hygienic condition prescribed is liable to prosecution under TCPH Act  
1955 (Travencore Cochin Public Health act)

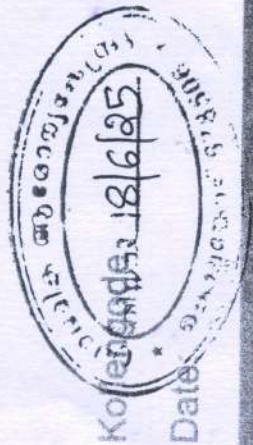

*CP 18/06/2025*  
HEALTH INSPECTOR  
Primary Health Centre  
Kollengode  
Health Inspector



**KERALA WATER AUTHORITY**  
**QUALITY CONTROL SUB DISTRICT LABORATORY**

CHITTUR- PALAKKAD

Telephone No: 04923-221056, E-mail: qcSDLkwaetr@gmail.com

Test Report


Test Report. No.:KWA/QCSDL/CTR-PKD/S -001982/04/2025


Report Date :11/04/2025

Customer Name & Address		1. Date of Receipt : 08/04/2025		
Chinmaya vidyalaya Kollengode Palakkad Pin:- 678506		2. Sampling done by : The Customer		
		3.UID No.of Sample:KWA/QCSDL/CTR-PKD/S-001982/04/25		
		4. Source of Sample : Open well		
		5. Sample condition :GOOD		
		6. Name of sample : Water		
		7. Sample Quantity : 100ml		
		8. Test Performing Dates		
		From : 08/04/2025 To : 11/04/2025		
Sl. No.	Parameters	Acceptable limits as per IS 10500 - 2012	Test Method	Result
1	Total Coliforms	Shall not be detected / 100ml	IS 15185 : 2016 ISO 9308 - 1 : 2014	Not Detected
2	E. Coli	Shall not be detected/ 100ml	IS 15185 : 2016 ISO 9308 - 1 : 2014	Not Detected

Remarks:-

*NB:- The results stated above related only to the sample(s) submitted for testing. This test certificate shall not be reproduced except in full without the written approval of the Laboratory.*

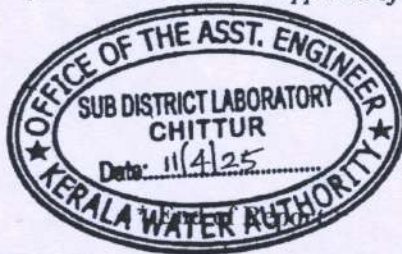

  
GIRISH KUMAR. M  
Reviewed and Authorized By  
BACTERIOLOGIST  
QUALITY CONTROL SUB DISTRICT LAB  
KERALA WATER AUTHORITY

Issue Date: 10/02/2023	Issue No:2	KWA/QCSDL/CTR-PKD/R.NO:3
Rev.No: 00	Rev Date: 00	Page 1of 1

*Handwritten signature and date: 24/6/2025*



**KERALA WATER AUTHORITY**  
**QUALITY CONTROL SUB DISTRICT LABORATORY**  
 CHITTUR - PALAKKAD  
 Telephone No - 04923-221056, E-mail - qcsdlctr@gmail.com

Test Report

Test Report No.:KWA/QCSDL/CTR-PKD/S -001468/03/2025

Report Date :17/03/2025

Customer Name & Address  Mrudhula M R Principal Chinmaya Vidyalaya Kollengode Palakkad Pin:- 678506		1. Date of Receipt : 14/03/2025		
		2. Sampling done by : The Customer		
		3.UID No.of Sample:KWA/QCSDL/CTR-PKD/S-001468/03/25		
		4. Source of Sample : Open well		
		4. Purpose of sample: Domestic		
		5. Sample condition :GOOD		
		6. Name of sample : Water		
		7. Sample Quantity : 100ml		
		8. Test Performing Dates From : 14/03/2025 To : 17/03/2025		
Sl. No.	Parameters	Acceptable limits as per IS 10500 - 2012	Test Method	Result
1	Total Coliforms	Shall not be detected / 100ml	IS 15185 : 2016 ISO 9308 - I : 2014	140
2	E. Coli	Shall not be detected/ 100ml	IS 15185 : 2016 ISO 9308 - I : 2014	Not detected

Remarks:-


NB:- The results stated above related only to the sample(s) submitted for testing. This test certificate shall not be

Reviewed by:

Girish kumar - M

Authorized By

Girish kumar - M

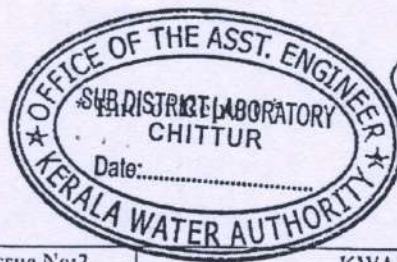

BACTERIOLOGIST

BACTERIOLOGIST

Issue Date: 17/03/2025	LAB Issue No: 2	KWA/QCSDL/CTR-PKD/R.NO: 3
Rev. No: 00	Rev Date: 00	Page 1 of 1

24/06/25



**KERALA WATER AUTHORITY**  
**QUALITY CONTROL SUB DISTRICT LABORATORY**  
**CHITTUR- PALAKKAD**  
 Telephone No - 04923-221056, E-mail - qcsdlctr@gmail.com

Test Report

Test Report. No.:KWA/QCSDL/CTR-PKD/S -001468/03/2025

Report Date :17/03/2025

Customer Name & Address			1. Date of Receipt : 14/03/2025		
Mrudhula M R Principal Chinmaya Vidyalaya Kollengode Palakkad Pin:- 678506			2. Sampling done by : The Customer		
			3.UID No.of Sample:KWA/QCSDL/CTR-PKD/S-001468/03/25		
			4. Source of Sample : Open well		
			4. Purpose of sample: Domestic		
			5. Sample condition :GOOD		
			6. Name of sample : Water		
			7. Sample Quantity : 2 litre		
			8. Test Performing Dates		
Sl. No.	Characteristics	Unit	Test Method	Acceptable limits as per IS 10500 - 2012	Result
1	Colour	HU	IS 3025 (part 4) : 2022 Platinum Cobalt Visual Comparison Method	5	5.00
2	Odour		IS 3025 (part 5-2018)	AGREEABLE	AGREEABLE
3	Turbidity	(NTU)	IS 3025 (part 10) - 2023 Nephelometric method	1	0.25
4	pH at 25°C		IS 3025 (part 11) - 2022 Electrometric method	6.5 to 8.5	7.38
5	Total Alkalinity (as CaCO <sub>3</sub> )	(mg/litre)	IS 3025 (part 23) - 2023 Indicator method	200	266.50
6	Total Dissolved Solids (TDS)	(mg/litre)	IS 3025 (part 16) - 2023 Gravimetric method	500	453.60
7	Total Hardness (as Ca CO <sub>3</sub> )	(mg/litre)	IS 3025 (part 21) - 2009 (R. 2019) EDTA Titration method	200	279.48
8	Calcium (as Ca)	(mg/litre)	IS 3025 (part 40) - 1991 (R. 2019) EDTA Titration method	75	53.25
9	Magnesium (as Mg)	(mg/litre)	APIA 3500-Mg.B Calculation method	30	36.21
10	Chloride (as Cl)	(mg/litre)	IS 3025 (part 32) - 1988 (R. 2019) Argentometric titration	250	104.58


**Remarks:-**

*NB:- The results stated above related only to the sample(s) submitted for testing. This test certificate shall not be reproduced except in full without the written approval of the Laboratory.*

JISHA-K   
 Reviewed by:

JISHA-K   
 Authorized By

Issue Date: 25/07/2021	District Lab	Issue No: SUB DISTRICT LABORATORY	KWA/QCSDL/CTR-PKD/03
Rev.No: 00	WATER AUTHORITY	Rev Date: 00	CHITTUR

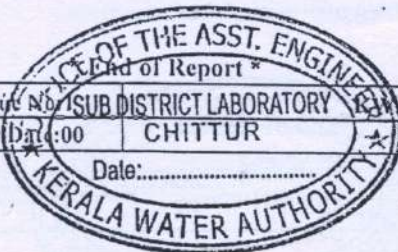

*17/03/2025*