

**PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION
CERTIFICATE**


No. HC/48/2026

Dated: 10.07.2026

It is certified that an inspection team headed by Medical Officer (In Charge), Family Health Centre, Kumaramangalam, inspected Al-Azhar Public School, , Idukki (Dt) on 08.07.2026 and on the basis of Water Test Report (Attached) bearing No:KWA/QCSDL/TDPA/F/6/344/26 dated 26.06.2026, Quality Control Sub District Laboratory, Thodupuzha, Idukki (Dt), Kerala-685585, Kerala Water Authority, Govt. of Kerala (PHED Lab) certified that Al-Azhar Public School has safe drinking water facilities for the students and members of staff of the institution. School also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Kerala State Government.

This certificate is valid till 09.07.2027

To
The Principal
Al-Azhar Public School,
Perumpillichira P O,
Idukki (Dt)

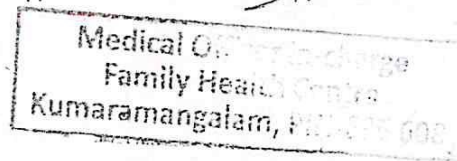


Principal
Al-Azhar Public School
Perumpillichira
Thodupuzha - 685 605




Chairman
Al-Azhar Public School




KERALA WATER AUTHORITY

QUALITY CONTROL SUB DISTRICT LAB, THODUPUZHA IDUKKI-685585 WATER TEST-BACTERIOLOGY REPORT

KWA/QCSDL/TDPA/F/6/344/26		Report Issue Date : 26.06.2026		
Customer Name & Address		Date of Receipt of payment	22.06.2026	
AL AZHAR PUBLIC SCHOOL PERUMPILICHIRA P O PERUMPILICHIRA		Date of Sample received	22.06.2026	
		Sampling Given by	Customer	
		Sample Code	TDPA 344	
		Sample Name	Well Water	
		Sample Condition	Good	
		Source of Sample	Well	
		Sample Quantity	200 ml	
		Test performing dates	From: 22.06.2026 to 24.06.2026	
Sl. No.	Source	Test Method	No of Total Coliforms per 100ml of sample	E.Coli in 100ml of sample
1	Water sample submitted by the customer	IS 15185:2016 (Reaffirmed 2021)	Nil	Nil

Remarks:-

NB:-The result stated above related only to the sample(s) submitted for testing by the customer. The test certificate shall not be reproduced except in full without the written approval of the Laboratory.



Analysed by
Name & Designation *Divya P S*

KWA/QCSDL/TDPA/F/05	Issue : 1	Issue Date : 01.07.2021
Rev. No: 1	Rev.Date : 01.03.2022	Page 3 of 3
End of Report		

Principal
Principal
Al-Azhar Public School
Perumpillichira
Thodupuzha - 685 605



Chairman
Chairman
Al-Azhar Public School



KERALA WATER AUTHORITY

QUALITY CONTROL SUB DISTRICT LAB, THODUPUZHA, IDUKKI-685585

(NABL Recognized Sub Divisional Level Government Drinking Water Testing Laboratory)

WATER TEST REPORT

22 06 2026 to 22 06 2026

AL AZHAR PUBLIC SCHOOL PERUMPILLICHIRA P O PERUMPILLICHIRA			Report Issue Date 28.06.2026			
			Date of Receipt of Payment 22.06.2026			
			Date of Sample Received 22.06.2026			
			Sampling Given by Customer			
			Sample Code TDPA 344			
			Sample Name Well Water			
			Sample Condition Good			
			Source of Sample Well			
			Sample Quantity 2 Litre			
			Test performing date From 22.06.2026 to 22.06.2026			
Sl No	Characterstics	Unit		Acceptable Limit as per IS 10500-2012	Permissible limits in absence of alternate source	Result
1	Colour	Hazen	IS 3025 (Part 4)-2021	5	15	1
2	Odour	-	IS 3025 (Part 5)-2018	Agreeable	Agreeable	Agreeable
3	Turbidity	(NTU)	IS 3025 (Part 10)-2023	1.0	5.0	0.37
4	pH at 25 °C	-	IS 3025 (Part 11)-2022	6.5 to 8.5	No relaxation	5.48
5	Total Dissolved Solids (TDS)	(mg/litre)	IS 3025 (Part 16)-2023	500	2000	28
6	Total Alkalinity	(mg/litre)	IS 3025 (Part 23)-2023	200	600	19.80
7	Chloride (as Cl)	(mg/litre)	IS 3025 (Part 32)-1988(Reaffirmed 2019)	250	1000	13.7
8	Calcium (as Ca)	(mg/litre)	IS 3025 (Part 40)-2024	75	200	8.09
9	Magnesium (as Mg)	(mg/litre)	IS 3025 (Part 46)-2023	30	100	2.42
10	Total Hardness (as CaCO ₃)	(mg/litre)	IS 3025 (Part 21)-2009(Reaffirmed 2019)	200	600	30.30

Remark

NB - The result stated above related only to the sample(s) submitted for testing by the customer. The test certificate shall not be reproduced except in full without the written approval of the Laboratory.



Analysed By *[Signature]*


KWA/QCSDL/TPA/F/6	Issue 1	Issue Date 01.07.2021
Rev No 12	Rev Date 09.10.2024	Page 1 of 3

[Signature]
Principal
Al-Azhar Public School
Perumpillichira
Thodupuzha - 685 605



End of Report

[Signature]
Chairman
Al-Azhar Public School



KERALA WATER AUTHORITY

QUALITY CONTROL SUB DISTRICT LAB, THODUPUZHA, IDUKKI-685585
WATER TEST REPORT

AL AZHAR PUBLIC SCHOOL PERUMPILLICHIRA P O PERUMPILLICHIRA			Report Issue Date 26 06 2026			
			Date of Receipt of Payment		22 06 2026	
			Date of Sample Received		22 06 2026	
			Sampling Given by		Customer	
			Sample Code		TOPA 344	
			Sample Name		Well Water	
			Sample Condition		Good	
			Source of Sample		Well	
			Sample Quantity		2 Litre	
			Test performing date		From 22 06 2026 to 22 06 2026	
Sl.No	Characteristics	Unit		Acceptable Limit as per IS 10500 2012	Permissible limits in absence of alternate source	Result
1	Nitrate (as NO ₃)	(mg/litre)	Phenol Di- Sulphonic Acid Method	45	No relaxation	377
2	Iron (as Fe)	(mg/litre)	IS 3025 (Part 53)-2024	1	No relaxation	0.01
3	Acidity	(mg/litre)	IS 3025 (Part 22)-1986 (Reaffirmed 2019)	-	-	19.80
4	Electrical conductivity at 25°C	(micromhos/cm)	IS 3025(Part 14)-2013 (Reaffirmed 2019)	-	-	55.10
5	Fluoride (as F)	(mg/litre)	SPADNS Method 23rd Edition (SPADNS 2017)	1	1.5	-
6	Sulphate	(mg/litre)	IS 3025 (Part 24/sec 1) 2022	200	400	579
7	Residual Chlorine	(mg/litre)	IS 3025 (Part 26)-2021	0.2	-	-

Remark:

NB:-The result stated above related only to the sample(s) submitted for testing by the customer. The test certificate shall not be reproduced, except in full, without the written approval of the Laboratory.



Analysed By

KWA/OCSDL/TOPA/F/6	Issue: 1	Issue Date: 01 07 2021
Rev. No: 12	Rev Date: 09 10 2024	Page 2 of 3

Principal
Al-Azhar Public School
Perumpillichira
Thodupuzha - 685 605



Chairman
Al-Azhar Public School