

**PROFORMA FOR SAFE DRINKING WATER AND SANITARY  
CONDITION CERTIFICATE**

No. 09

कार्यालय सहायक यंत्री  
श्रीरू स्वा. यांत्रिकी उपखण्ड  
तराना जिला उज्जैन

Dated: 07/01/2026It is certified that an inspection team headed by RAJESH HOLKAR(Name of Officers with designation) from P. H. E. SUB-DIVISION, TARANAPHED inspected the KOLPING CONVENT HR. SEC. SCHOOL, KANASIYA, TEHSIL- TARANA, DIST. - UJJAIN, MP on 22/12/2025 and on the basis of Water Test Report (Attached) bearing no. 115dated 22/12/2025 of NABL - UJJAIN, DIST.- UJJAIN(PHED Lab) certified that the KOLPING CONVENT HR. SEC. SCHOOL, KANASIYA, TEHSIL- TARANA, DIST. - UJJAIN,MP has safe drinking water facilities for the students and members of staff of the institution. School is also

maintains the hygienic sanitation condition in the school building &amp; the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 6 MONTHS


सहायक यंत्री  
श्रीरू स्वा. यांत्रिकी उपखण्ड  
तराना जिला-उज्जैन

Signature with seal :-

Name :-

:- RAJESH HOLKAR

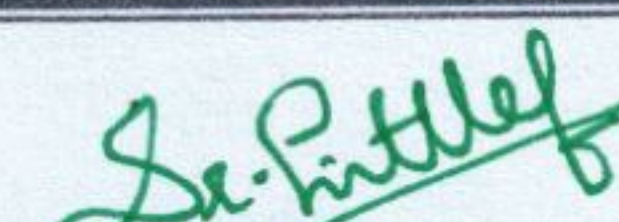
Designation :-

:- ASSISTANT ENGINEERName & address of the office/Department: - P. H. E. SUB-DIVISION, TARANA

To,  
KOLPING CONVENT HR. SEC. SCHOOL,  
KANASIYA, TEHSIL- TARANA, DIST. - UJJAIN, MP  
(Name and address of the institution)

**Note: The certificate is to be issued by authorized officer / PHED Lab/local bodies**

  
MANAGER  
KOLPING CONVENT HR. SEC. SCHOOL  
KANASIYA DISTT. UJJAIN M.P.

  
PRINCIPAL  
Kolping Convent H.S. School  
Kanasiya (442070)

Laboratory

# PUBLIC HEALTH ENGINEERING DEPARTMENT

P.H.E. Division, Ujjain (M.P.)

Block.....नरना.....Panchayat.....कनासिया.....Village Name.....कनासिया  
 Sample From.....कोलपिंग कॉन्वेंट हायर सेकेण्डरी स्कूल, कनासिया, नर-खाना, जिला-उज्जैन  
 Reference No./Date.....दिनांक - 19/12/25  
 Particulars of Sample.....वाटर सेम्पलस ऑफ बोरेवेल एव आर.ओ.  
 Date of collection.....19/12/25.....Date of Analysis.....22/12/25  
 Location / Sample No.....  
 ① बोरेवेल  
 ② आर.ओ.

S No.	Characteristics	Unit	As per manual I.S. 10500 1991 Water Treatment		Result					
			Acceptable	cause for rejee	1	2				
<b>PHYSICAL</b>										
1.	Turbidity	NTU	5.0	10.0	1.9	0.1				
2.	Colour	P/Cebalt Scale	5.0	25.0	Nil	Nil				
3.	Taste and about	-	unobjectionable	objectionable	Nil	Nil				
<b>CHEMICAL</b>										
4.	pH	pH Scale	6.5 to 8.5		8.40	8.15				
5.	Alkalinity	mg/l			106	62				
<b>Total Alkalinity</b>										
6.	Cholorides	mg/l	250	1000	-	-				
7.	Nitrate (as No.)	-	-	45	-	-				
8.	Total Hardness	-	300as Caco <sub>3</sub>	600as Caco <sub>3</sub>	102	100				
9.	Calcium Hardness	-	75 as Ca	200 as Ca	40	52				
10.	Magnesium Hardness	-	30 as Mg	50 as Mg	14.88	11.52				
11.	Total Solids	-	-	-	-	-				
<b>a) Dissolved Solids</b>										
<b>b) Suspended Solids</b>										
12.	Iron	mg/l	0.1	1.0	-	-				
13.	Fluorides	-	1.0	1.5	-	-				
14.	Residual Chlorine	-	0.2	1.0	-	-				
15.	M.P.N.	-	-	-	-	-				
16.	CONDUCTIVITY	-	-	-	43	54				

कार्यालय प्रयोगशाला प्रभारी  
 लोक स्वास्थ्य यंत्रिका खण्ड उज्जैन  
 आवक क्रं. 115  
 दिनांक 22/12/25

*Manager Signature*  
 MANAGER  
 KOLPING CONVENT HR. SEC.SCHOOL  
 KANASIYA DISTT. UJJAIN M.P.

*Principal Signature*  
 PRINCIPAL  
 Kolping Convent H.S. School  
 Kanasiya (442070)

